

Changeover operating mechanism for contactors 3RT105, 3RT145
AC (50...60 Hz) / DC operation, 110 ... 127 V Operating mechanism:
Standard,economy circuit Screw terminal



General technical data	
Product brand name	SIRIUS
Product designation	Magnet coil
Control circuit	
Type of voltage of the control supply voltage	AC/DC
Control supply voltage	
• 2 at AC	
— at 50 Hz rated value	
— at 60 Hz rated value	127 V
Control supply voltage	127 V
• 2 at DC rated value	127 V
Certificates/ approvals	

General Product Approval	EMC	Functional Safety/Safety of Machinery	Declaration of Conformity
--------------------------	-----	---------------------------------------	---------------------------



Type Examination Certificate



Declaration of Conformity	Test Certificates	Shipping Approval
---------------------------	-------------------	-------------------

Miscellaneous

Special Test Certificate

Type Test Certificates/Test Report



Shipping Approval	other	Railway
-------------------	-------	---------





Confirmation

Miscellaneous

Special Test Certificate

Further information

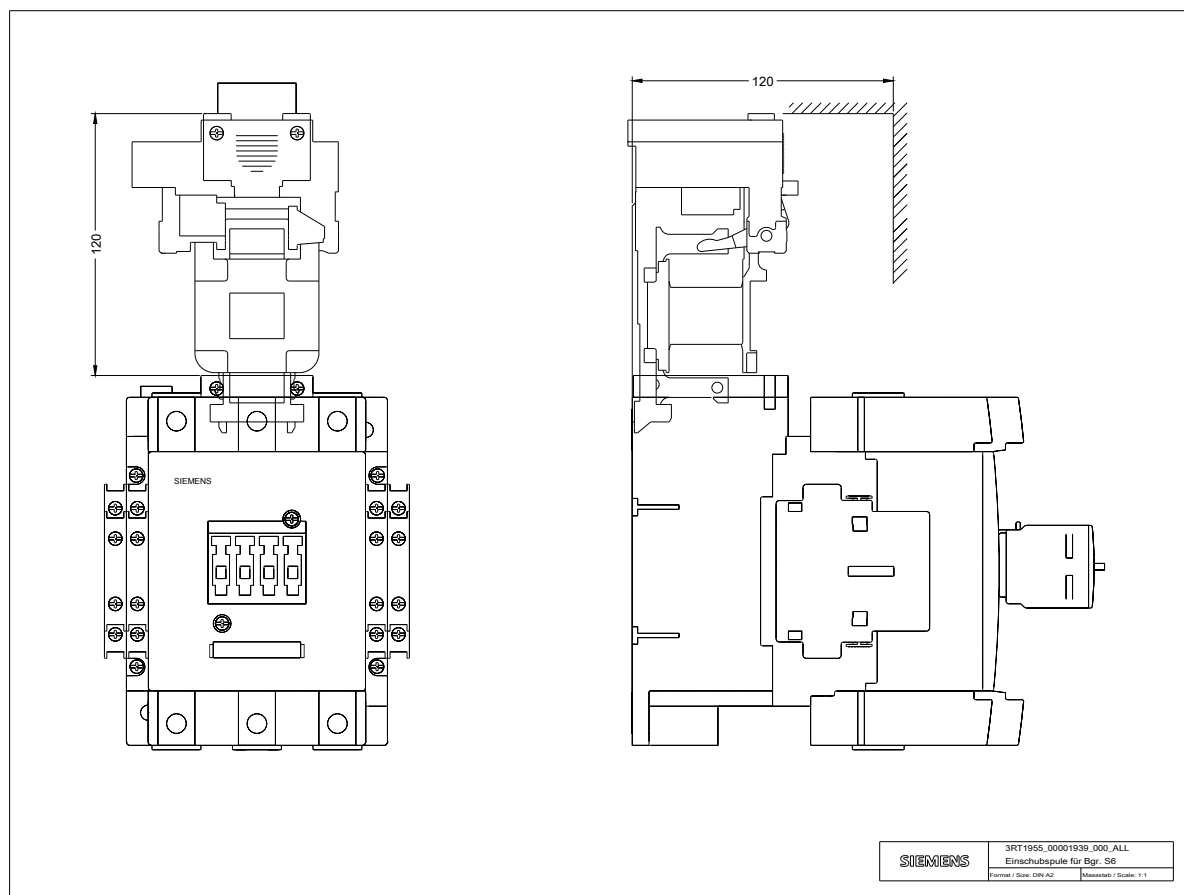

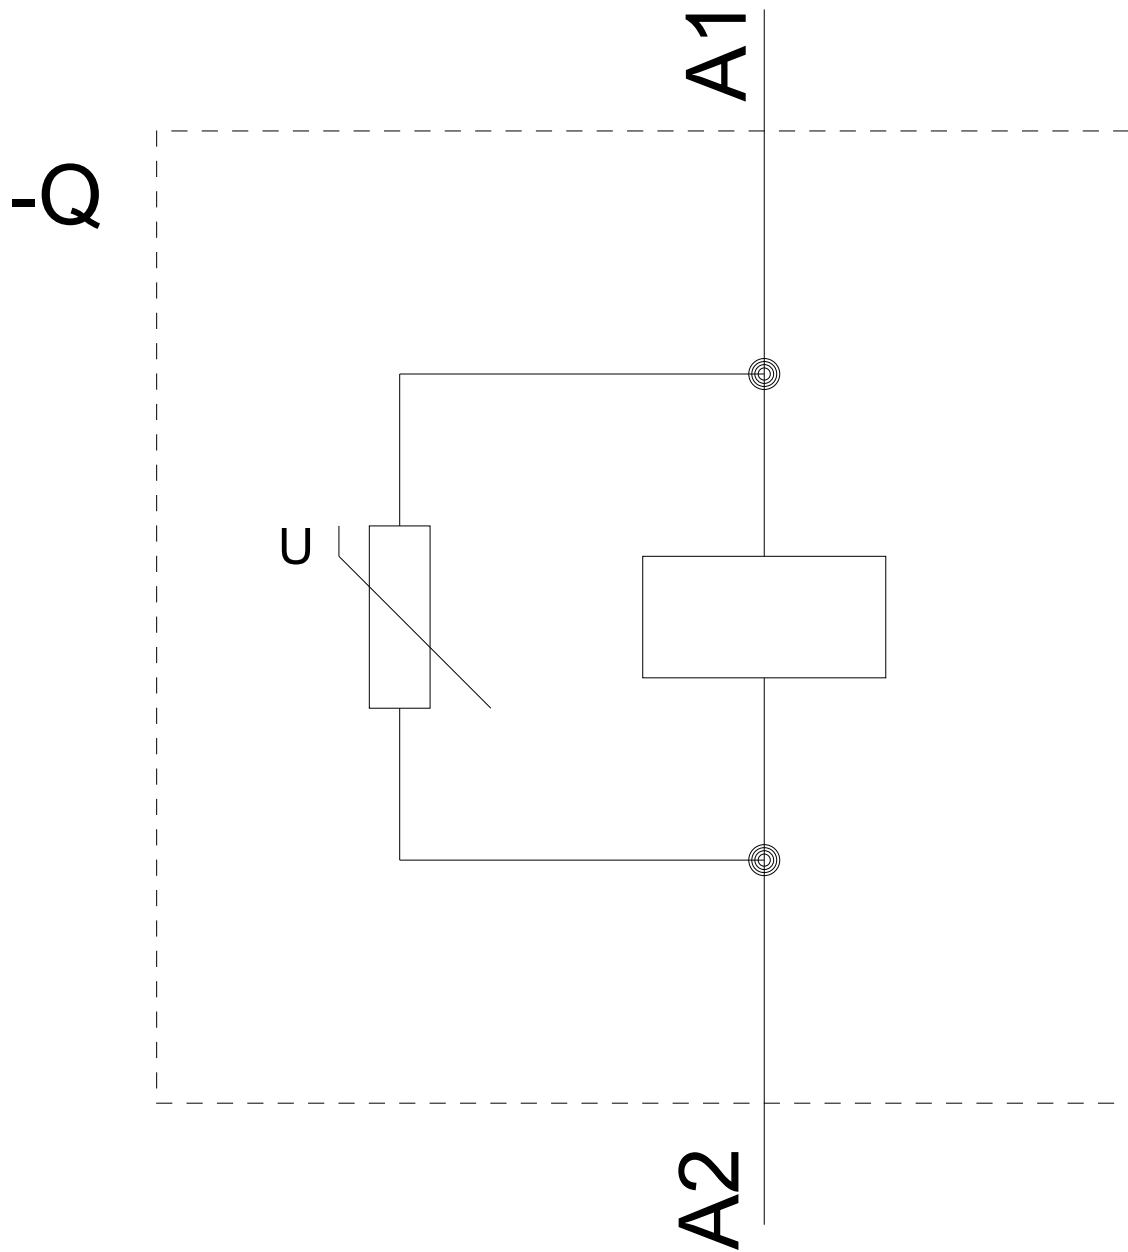

last modified:

03/05/2020